


DEPARTMENT OF HEALTH AND HUMAN SERVICES
CENTERS FOR MEDICARE & MEDICAID SERVICES

PRINTED: 06/08/2015
FORM APPROVED
OMB NO. 0938-0391

STATEMENT OF DEFICIENCIES AND PLAN OF CORRECTION		(X1) PROVIDER/SUPPLIER/CLIA IDENTIFICATION NUMBER: 185266	(X2) MULTIPLE CONSTRUCTION A. BUILDING 01 - MAIN BUILDING 01 B. WING _____		(X3) DATE SURVEY COMPLETED 05/20/2015
NAME OF PROVIDER OR SUPPLIER ELIZABETHTOWN NURSING AND REHABILITATION CENTER			STREET ADDRESS, CITY, STATE, ZIP CODE 1101 WOODLAND DRIVE ELIZABETHTOWN, KY 42701		
(X4) ID PREFIX TAG	SUMMARY STATEMENT OF DEFICIENCIES (EACH DEFICIENCY MUST BE PRECEDED BY FULL REGULATORY OR LSC IDENTIFYING INFORMATION)	ID PREFIX TAG	PROVIDER'S PLAN OF CORRECTION (EACH CORRECTIVE ACTION SHOULD BE CROSS-REFERENCED TO THE APPROPRIATE DEFICIENCY)	(X5) COMPLETION DATE	
K 147	Continued From page 26 section shall not be used for storage. When normally enclosed live parts are exposed for inspection or servicing, the working space, if in a passageway or general open space, shall be suitably guarded. (C) Entrance to Working Space. (1) Minimum Required. At least one entrance of sufficient area shall be provided to give access to working space about electrical equipment. (2) Large Equipment. For equipment rated 1200 amperes or more and over 1.8 m (6 ft) wide that contains overcurrent devices, switching devices, or control devices, there shall be one entrance to the required working space not less than 610 mm (24 in.) wide and 2.0 m (6½ ft) high at each end of the working space. Where the entrance has a personnel door(s), the door(s) shall open in the direction of egress and be equipped with panic bars, pressure plates, or other devices that are normally latched but open under simple pressure. A single entrance to the required working space shall be permitted where either of the conditions in 110.26(C)(2)(a) or (b) is met. (a) Unobstructed Exit. Where the location permits a continuous and unobstructed way of exit travel, a single entrance to the working space shall be permitted. (b) Extra Working Space. Where the depth of the working space is twice that required by 110.26(A)(1), a single entrance shall be permitted. It shall be located so that the distance from the equipment to the nearest edge of the entrance is not less than the minimum clear distance specified in Table 110.26(A)(1) for equipment operating at that voltage and in that condition. (D) Illumination. Illumination shall be provided for all working spaces about service equipment, switchboards, panelboards, or motor control centers installed indoors. Additional lighting	K 147	survey The membership of this committee consist of at least the medical director, pharmacy consultant, director of nursing, assistant director of nursing, business office manager, social service director, and the administrator. The committee meets at least quarterly and more frequently as they deem necessary when monitoring plans of corrections. This PI Quality Committee will review the effect of the implemented changes and the audit findings, and if at any time concerns are identified during this monitoring process, the PI Quality Committee will be convened to analyze and recommend any further interventions, as deemed appropriate.		

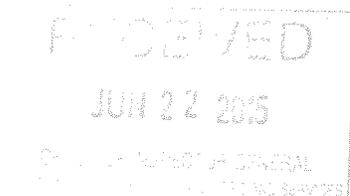

DEPARTMENT OF HEALTH AND HUMAN SERVICES
CENTERS FOR MEDICARE & MEDICAID SERVICES

PRINTED: 06/08/2015
FORM APPROVED
OMB NO. 0938-0391

STATEMENT OF DEFICIENCIES AND PLAN OF CORRECTION		(X1) PROVIDER/SUPPLIER/CLIA IDENTIFICATION NUMBER: 185266	(X2) MULTIPLE CONSTRUCTION A. BUILDING 01 - MAIN BUILDING 01 B. WING _____	(X3) DATE SURVEY COMPLETED 05/20/2015
NAME OF PROVIDER OR SUPPLIER ELIZABETHTOWN NURSING AND REHABILITATION CENTER			STREET ADDRESS, CITY, STATE, ZIP CODE 1101 WOODLAND DRIVE ELIZABETHTOWN, KY 42701	
(X4) ID PREFIX TAG	SUMMARY STATEMENT OF DEFICIENCIES (EACH DEFICIENCY MUST BE PRECEDED BY FULL REGULATORY OR LSC IDENTIFYING INFORMATION)	ID PREFIX TAG	PROVIDER'S PLAN OF CORRECTION (EACH CORRECTIVE ACTION SHOULD BE CROSS-REFERENCED TO THE APPROPRIATE DEFICIENCY)	(X5) COMPLETION DATE
K 147	Continued From page 27 outlets shall not be required where the work space is illuminated by an adjacent light source or as permitted by 210.70(A)(1), Exception No. 1, for switched receptacles. In electrical equipment rooms, the illumination shall not be controlled by automatic means only.	K 147		

